


CAVITCLAD™ Specification

Exterior Plasterwork Specifications and Design Solutions

Project Name:
Project Address:
Specification Prepared For:
Specifiers Name:
Date:
Licensed Specialized Plastering Contractor:
License Number:

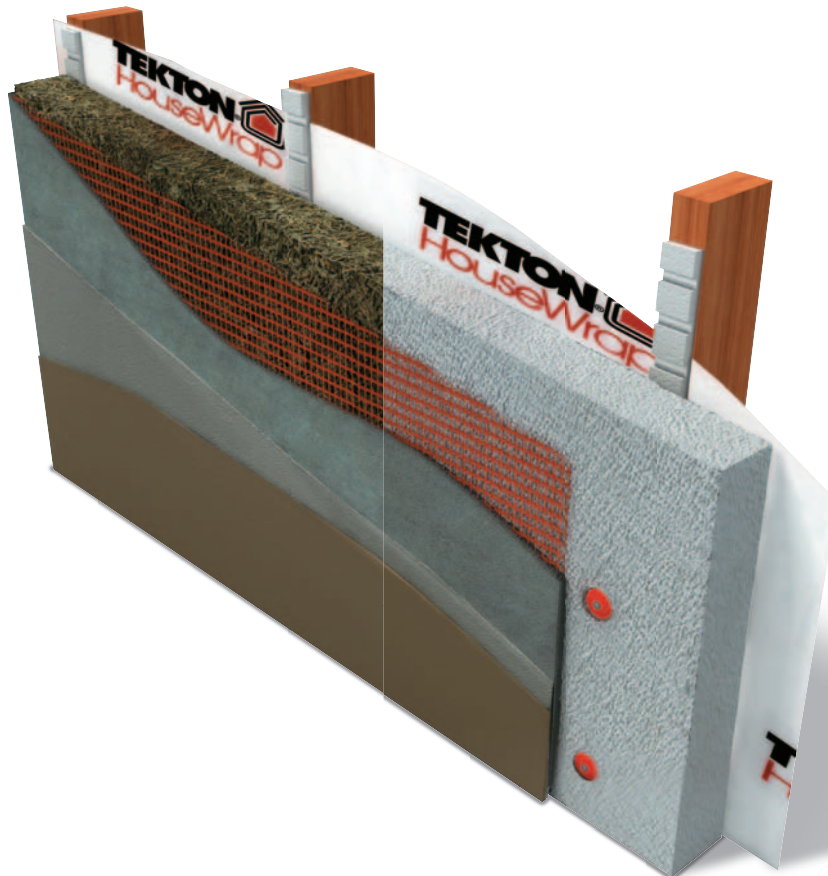

■ Introduction

This specification is for the application of Specialized Construction Products Caviteclad Exterior Insulation and Finishing System (EIFS). The Caviteclad system is made up of either 50mm polystyrene sheets (EPS) or 50mm mineralised woodwool Permapanels that are fixed to timber or steel framing over the surface of a 20mm cavity. The chosen backing substrate is then overcoated and reinforced with a range of specially blended proprietary cement based plasters before the walls are finished with a finishing plaster chosen from Specialized' range and painted with a 100% acrylic paint system. Both the EPS and the Permapanels can also be bonded or mechanically fixed to concrete or masonry walls (Note: This application is outside the scope of the BRANZ Appraisal).

All the PVC flashings, fibreglass mesh, resin, fixings and plaster components used for the Caviteclad System must be supplied by Specialized Construction Products Ltd or one of its certified distributors.

The Caviteclad System has been tested and BRANZ appraised for use throughout New Zealand and is the subject of BRANZ Appraisal No. 510 (2008).

This specification has been set out as near as possible to the actual construction sequence and it must be read in conjunction with the detail data sheets for the Caviteclad System and the Caviteclad Installation Guide.

■ Framing Set Out (Timber or Steel)

Timber framing must comply with NZS 3604 for buildings or parts of buildings within the scope limitations of NZS 3604. Buildings or parts of buildings outside the scope of NZS 3604 must be to a specific design in accordance with NZS 3603 and NZS 4203. In all cases studs must be set out at 600mm maximum centres. Dwangs/nogs must be flush fitted at maximum 800mm centres. Edge fixing for the polystyrene sheets **must** be provided. All soffit junctions, openings, wall/roof junctions and foundation details must have support for the sheet edges. Timber framing must have a maximum moisture content of 24% at the time cladding commences. For steel framing the minimum framing specification is 'C' section studs and nogs of overall section size 75mm web and 32mm flange. Steel thickness must be a minimum of 0.55mm.

■ Building Wrap

A paper wrap complying with NZBC Acceptable Solution E2/AS1 Table 23, or breather-type membranes covered by a valid BRANZ appraisal must be used in all circumstances. Building wrap must be installed horizontally and be continuous around corners. The wrap must be lapped 75mm minimum at horizontal joints and 150mm minimum over studs at vertical joints. Where studs are at greater than 450mm centres, polypropylene strap or additional vertical cavity battens must be installed at maximum 300mm centres to prevent bulk insulation bulging into the cavity. Flexible sill and jamb flashing tapes complying with NZBC Acceptable Solution E2/AS1, paragraph 4.3.11 or flexible sill and jamb flashing tapes covered by a valid BRANZ Appraisal must be used around all penetrations. All penetrations must have internal air seals applied.

■ Head Flashings

Proprietary PVC head flashings with minimum ventilation openings of 1000mm² per lineal metre must be installed over all window heads and door openings. If proprietary PVC head flashings can not be used, an acceptable alternative flashing must be provided. Please contact Specialized Construction Products Ltd for advice.

■ Flashings In General

Joists designed to carry decks need to have a continuous flashing fitted before the polystyrene is fixed. Check if there are any special back-flashings required where the Caviteclad joins another substrate or curtain wall construction.

■ Roofing

Where areas over roofs need to be plastered, the roof/wall flashing must be installed prior to the commencement of cladding.

■ Pipes & Meter Boxes

It is critical that pipes are flashed appropriately in accordance with E2/AS1 fig 68. All pipes must have the building wrap turned to the outside of the building and have the building paper taped to the outside of the pipe. All pipes must have a downward rake of a minimum of 5° and must be sealed in place using MS Silaflex or another approved equivalent both before plastering and after the installation of the Caviteclad base coat. All meter boxes must be correctly flashed in accordance with the detailed drawings for the Caviteclad System. Particular attention to detail and workmanship must be given to the weatherproofing details contained in the technical literature relating to flashing and sealing building penetrations or junctions with other building materials. All junctions between the Caviteclad substrate and dissimilar materials must be correctly flashed and sealed with MS Silaflex or another approved equivalent. The MS sealant must be installed in strict accordance with the manufacturer's requirements and must be left to properly cure prior to plastering.

■ Site Storage

Products in dry form must be stored in a dry area, off the floor on a timber pallet or timber dunnage and it must be protected from the weather and from mechanical damage. Stock must be rotated to ensure that the oldest material is used first. Plaster stock that is older than six months must be discarded. EPS sheets, battens, uPVC flashings and profiles must be protected from direct sunlight and physical damage. They should be stored flat and under cover. Liquid components must be stored in a frost free area.

■ Preparation Of Masonry & Concrete Surfaces

(Note: This application is outside the scope of the BRANZ Appraisal.)

All surfaces to receive a direct bonded application of the Caviteclad System must be clean and free of debris, dirt and dust, efflorescence, grease, oils, curing agents, cleaning solutions, mould and algae or any other contaminants that may affect adhesion. Painted or glossy surfaces must be specially treated prior to the application of any plaster material, please refer to Specialized Construction Products for specialist advice before you proceed. All cracks that may be the subject to ongoing movement must be correctly repaired and reinforced. Some smooth, dense concrete surfaces must be slush coated before the application of the polystyrene bonding plaster to ensure suitable adhesion is created, please refer to Specialized Construction Products for specialist advice before you proceed. Tilt slab and other precast concrete items should be chemically cleaned with a water blaster to ensure any mould release agents are removed before the plaster is applied. All very porous surfaces should be sealed with an appropriate paint sealer prior to the application of the bonding plaster. Failing to correctly prepare the masonry substrate, may affect the aesthetic appearance of the finished wall. Do not wet down masonry surfaces before plastering and do not apply base coat plaster to surfaces that are wet from rain or overnight dew.

■ Caviteclad Battens

Caviteclad battens for use under an EPS substrate are manufactured from high density (Class H) expanded polystyrene with an approximate density of 24kg/m³ and measuring 21mm x 45mm. Caviteclad battens for use under a Permapanel substrate are manufactured from ultra high density (Class UH) expanded polystyrene with an approximate density of 28kg/m³ and measuring 21mm x 50mm. All battens must be stapled to the framing or alternatively glued to the chosen building paper in accordance with the batten layout shown in the detail data sheets. Additional vertical battens are required at internal and external corners and openings. At the soffit and external corners the airflow must be blocked off and gables must be lined or incorporate an air barrier which meets the requirements of NZBC Acceptable Solution E2/AS1, Table 23. Non-rigid air barriers must have an air resistance of $\geq 0.1 \text{ MN s/m}^3$. Where rigid sheathings are used, the fixing length must be increased by a minimum of the thickness of the sheathing. Horizontal battens must be a maximum length of 100mm long in accordance with the requirements of NZBC Acceptable Solution E2/AS1, Paragraph 9.1.8.2(f) and must be stapled into place on all noggins/dwangs where required for fixings with a minimum of a 5 degree angle on the top edge. The fewer horizontal battens that are used the better.

■ Sill and Jamb Flashings

The use of the Caviteclad PVC sill and PVC Jamb flashings are **MANDATORY**. It is also **MANDATORY** that the sill and jamb flashings are joined in the corner with a 50mm Specialized Construction Products corner socket.

■ Soffits, Gable Ends & Unlined Walls

Soffits shall be fixed into place before the cladding is installed and allowance made to close off the cavity with framing or battens to stop airflow into the roof space. After the mesh and plaster system has been completed a 5mm bead of MS sealant or 'no more gaps' should be installed at the soffit polystyrene intersection. In the case of reverse raking soffits or soffits less than 450mm wide a flashing or piece of Protecto EIFS tape shall be provided in accordance with the details shown in the technical literature.

To ensure the EPS substrate is not affected by timber shrinkage in areas that are not traditionally lined (e.g. gable ends), it is highly recommended that the internal walls of these areas are adequately braced with a thin sheet of plywood or an alternative bracing material. Alternatively, the timber in these areas must have a moisture content of no greater than 18% and must remain that way throughout the entire construction process.

■ Fixing The Polystyrene Sheets

The sheets must be butt jointed except at corners where one sheet may overlap the other to form a straight finish. Horizontal sheet edges must be supported at fixing locations with cavity spacers a maximum of 100mm long in accordance with the requirements of NZBC Acceptable Solution E2/AS1, Paragraph 9.1.8.2(f). At the base of walls the finished level of the polystyrene must be **at least** 50mm below the supporting framing. Additional framing will be required at soffits, internal and external corners and window and door openings for the support and fixing of sheet edges.

All sheet joints and edges must be supported. The only exception to this rule is at the base where the sheets can hang 50mm below the supporting frame.

Construction joints are needed in walls longer than 20 metres or higher than two stories. This doesn't apply to two storey houses with a gable end that does not contain a penetration. Construction joint details are provided in the drawings provided with the system. Inter-storey drained joints must be provided for walls over 2 storeys in height in accordance with the requirements of NZBC Acceptable Solution E2/AS1, Paragraph 9.1.9.4(b). Inter-storey junctions must be constructed in accordance with the technical literature.

All gaps between the EPS sheets must be flush filled with adhesive spray foam prior to the base coat plaster being applied.

Any oxidization on the surface of the polystyrene must be removed with a stiff broom and water, and then the cleaned surface must be scratched to provide a key before plastering begins.

■ Fixing The Permapanel Sheets

The sheets are butt jointed except at corners where one sheet overlaps the other to form a straight finish. The Permapanels must be supported at fixing locations with cavity spacers a maximum of 100mm long in accordance with the requirements of NZBC Acceptable Solution E2/AS1, Paragraph 9.1.8.2(f). Permapanels can be jointed off nog, but should be jointed over studs. Each additional layer of panels must be installed so that the panel joints are staggered by a minimum of 250mm.

All panels must have their edges and their ends buttered with Stopit plaster as they are being installed. The Stopit plaster must be allowed to dry before the application of the mesh coat. The plaster should be mixed to a firm but easily pliable consistency and must cover the entire edge of the Permapanel before the next sheet is laid onto its edge. This practice should be done as quickly as possible to ensure the jointing compound remains as pliable as possible to aid in the adhesion of the panels. Once the panel has been joined and nailed into place any Stopit that bubbles out of the joint should be wiped flush on the surface either directly after fixing or once the jointing compound is dry. Care must be taken to ensure Stopit does not bubble out of the joint into the cavity.

At the base of walls the finished level of the Permapanel must be at least 50mm below the supporting framing. Additional framing will be required at soffits, internal and external corners and window and door openings for the support and fixing of sheet edges.

Construction joints must be provided as follows:

- Vertical control joints – at maximum 5.4 m centres; aligned with any control joint in the structural framing, or where the system abuts different cladding types.
- Horizontal control joints – at maximum 5.4 m centres and at inter-storey floor levels.

Construction joint details are provided in the drawings provided with the system. Inter-storey drained joints must be provided for walls over 2 storeys in height in accordance with the requirements of NZBC Acceptable Solution E2/AS1, Paragraph 9.1.9.4(b). Inter-storey junctions must be constructed in accordance with the technical literature.

The bottom edges of the Permapanels can either be capped with a 50mm High Back U-Channel which is attached through the cavity battens to the bottom plate of the dwelling prior to application or with a 50mm lipped base bead once they have been fixed into place and trimmed as may be necessary.

■ Timber Framing

There are four Wind Zone categories listed in NZS 3604: Low, Medium, High and Very High. The “Building Wind Zone” for the job to be completed must be clearly understood before the application of any plaster.

EPS

Polystyrene sheets are fixed through the cavity battens and spacers to the studs with 100 x 4mm hot-dipped galvanised nails topped with either 22mm or 42mm Specialized Construction Products Ltd “polyfasteners”. In Low and Medium Building Wind Zones, 22mm or 40mm diameter washers may be used. In High and Very High Building Wind Zones, 42mm diameter washers must be used.

Refer to the table right for fixing centres.

Wind Zone NZS 3604	EPS Fixing Centres For Edges And Intermediate Studs	
	22mm	42mm
Low ¹	200	300
Medium ¹	200	300
High ¹	N/A	300
Very High ²	N/A	200

PERMAPANEL

Permapanel sheets are fixed through the cavity battens and spacers to the studs with 100 x 4mm hot-dipped galvanised spring head nails or Specialized Construction Products Ltd “polyfasteners”. In all Building Wind Zones 22mm diameter washers may be used.

Refer to the table below for fixing centres.

Table 1: 100 mm hot-dip galvanised D-Head Gun Nails

NZS 3604 Building Wind Zone with studs at maximum 600 mm centres	Fixing centres (mm) to studs, dwangs, and top and bottom plates
Low	200
Medium	150
High	125
Very High	100

Table 2: 100 mm hot-dip galvanised FH Nails with 22 mm washers

NZS 3604 Building Wind Zone with studs at maximum 600 mm centres	Fixing centres (mm) to studs, dwangs, and top and bottom plates
Low – Very High	200

Table 3: 100 mm hot-dip galvanised FH Nails with 22 mm washers

Specifically designed buildings up to 2500 Pa ULS wind pressure with studs at maximum 600 mm centres	Fixing centres (mm) to studs, dwangs, and top and bottom plates
	125

Note: All nails must be fixed with an edge clearance of minimum 10 mm and the framing must be specifically designed with a minimum framing size of 90 x 45 mm Grade MSG8.

- Note:**
1. One fixing is required into each dwang and top and bottom plates at mid-dwang length.
 2. Fixings are also required into each dwang at 200mm centres and top and bottom plates at mid-dwang length.

Around Openings: Nail at 150mm to 200mm maximum centres around all windows and doors. This ensures any possible movement between the joinery frame and the finished Caviteclad is greatly reduced.

■ Steel Framing

The same fixing centres apply as for timber framing. Use Specialized Construction Products Ltd 42mm “polyfasteners” and self-drilling AS 3566 Corrosion Class 3 or 4, 6-gauge screws in NZS 3604 defined Corrosion Zones 1, 2, 3 and 4 and Grade 304 Stainless Steel, 6-gauge screws in the sea spray zone. The screw length must allow a 10mm minimum penetration through the steel framing.

■ Concrete & Masonry

(Note: This application is outside the scope of the BRANZ Appraisal.)

To bond polystyrene to masonry surfaces mix up Specialized Construction Products fine base coat plaster with the addition of 1 litre of Specialized Construction Products resin per bag. Cut the polystyrene to size and check the fit. Apply the fine base coat plaster to the back of the sheet with a grooved trowel around the perimeter and in vertical strips every 400mm. Polystyrene masonry anchors must be used to hold the sheets in place while the plaster is drying and to provide a mechanical fix for the polystyrene.

■ PVC Beads

All exposed corners and bottom edges must be protected by gluing on the appropriate PVC section. The beads are glued on with Sika Nailbond PB Adhesive.

■ Stopping Up Prior To Mesh Coating

Once the Permapanels or the EPS have been correctly fixed a two metre straight edge should be used to check the flatness of the walls surface. Durarasp should be used to sand off any large irregularities. Deviations in the surface of the Permapanels should be filled MLC plaster and screeded flat. Once the surface is flat and true all nail holes and PVC extrusions should be stopped with a layer of Fine Mesh Coat plaster to ensure any shrinkage in the mesh coat is kept to a minimum. Only once the walls are flat and true and have been well stopped should mesh coating commence.

■ Mesh Coating

The areas around all penetrations should be completed first using a soft flexible 160g/m² alkali resistant mesh followed by all the flat areas of wall using a 160g/m² alkali resistant hard mesh.

All mesh must overlap any adjacent drop by a minimum of 30mm. At the corners of all openings, a second layer of mesh 100 x 200mm (butterfly) must be applied and embedded in the mesh coat plaster on the diagonal to reduce the chance of any subsequent cracking at these high stress points.

■ Finishing Options

There are four options once the first mesh and plaster coat have been applied:

Option 1: Stucco Texture

Fine base coat plaster can be sprayed through a hopper gun or a sagola gun to achieve a heavy stucco plaster finish.

Option 2: Float Finish

Float Finish is a polymer modified cement based plaster which is polished flat to achieve a fine granular finish. The smooth plaster will not cover up background imperfections, particularly when walls are subject to side lighting at certain times of the day.

Option 3: Spanish Finish

Spanish Finish is a polymer-modified, cement based plaster used to achieve an undulating adobe style finish. This product can be applied in various thicknesses and using a number of different techniques. Before finish coating begins ensure the style of finish that is desired has been correctly communicated and understood by the plasterer. A trial sample is highly recommended.

Option 4: Fine Spray Texture

Spray texture is a granular plaster designed to give a fine stippled appearance. Spray texture is best applied using a sagola gun with a 7mm tip and with the compressor set at approximately 60psi.

■ Curing

The curing time of finishing plaster will vary due to ambient temperature, relative humidity, surface temperature, surface porosity, application methods, and/or the thickness of the material. All freshly applied material must be protected from inclement weather for a minimum of 24 hours after application. It is the responsibility of the plaster applicator to determine if the product is cured and/or dry prior to applying any additional coats that may be required or exposing the applied product to rain, snow, dew, and/or any other inclement weather condition that may have a detrimental affect. Although all the finishes contain cement and will not fully cure for 28 days, as long as it is lightly hosed down with fresh water 12 hours prior to painting, it can be painted after the finish coats have cured for a minimum of 3-4 days.

■ Painting

A full paint system must be used over the chosen Caviteclad finishing plaster to make the system weathertight and give the desired finish colour to exterior walls. Specialized's Plastershield is a 100% acrylic-based paint that has been specially formulated

for use over cement based plasters. Plastered surfaces must be coated with a minimum of 2 coats of Plastershield tinted to the selected colour and applied by brush and roller at a spread rate of approximately 6m²/litre.

As an alternative to Plastershield, a latex based exterior paint system complying with any of Parts 7, 8, 9 or 10 of AS 3730 may be used. The paint system must be applied in accordance with the paint manufacturer's instructions.

Other paint systems are not covered by this specification sheet and Specialized Construction Products Ltd will not warrant the use or suitability of alternative paint systems over the surface of its plaster finishes.

The chosen paint system must have a Light Reflective Value (LRV) of no less than 25.

■ Limitations

DO NOT apply plaster when the ambient or surface temperature is below 4°C or above 30°C or will be in that range for the 24-hour period after application. When hot, dry, or windy conditions exist, moist curing and protection must be provided. Material that is allowed to freeze or material that dries too quickly may suffer irreparable damage.

DO NOT add any other materials to the plasters used with the system or deviate from the mixing or application procedures outlined in any of Specialized Construction Product's technical data sheets without written approval from Specialized Construction Products Ltd.

DO NOT apply any plaster material unless the substrate has been properly cleaned and prepared.

DO NOT add any more water than prescribed by the technical data sheet for the individual products.

DO NOT wet the wall prior to the application of any plaster.

DO NOT reactivate any plaster with more water once it has begun to set.

DO NOT mix more plaster than you can use in 45 minutes.

NOTE: *Failure to follow the manufacturers written specifications could result in the following but not limited to spalling, cracking, peeling, chipping, delamination, discoloration, wash off, and overall system failure.*

■ Maintenance

Any paint film damage must be repaired as soon as possible to prevent water penetration and ensure that the high strength properties of the fibreglass mesh are maintained.

Any impact damaged areas must be thoroughly cleared of any loose material and repaired with a 1:1 mixture of resin and water mixed with the required amount of Caviteclad plaster. This will ensure a positive bond between the original plaster and the repaired area. Repaint within the following week.

The wall cladding system should be regularly cleaned, at least annually, by washing with clean water to remove dirt and to maintain the finish appearance. Grime may be removed with warm water and detergent. Plastered walls should be recoated with an approved paint system at 5 to 8 yearly intervals or sooner if required to maintain weathertightness. Regular checks, at least annually, must be made of the system to ensure that the weather resistant coating is maintained watertight, and that the sealant, flashings, and other joints continue to perform their function and do not allow water to penetrate. Failure to correctly maintain the system may void any longterm warranties offered with the system. Any accidental damage to the cladding must be repaired immediately using Specialized Construction Products materials.

■ Warranty

The recommendations, suggestions, statements and technical data provided by Specialized Construction Products Ltd are based on the best current knowledge available and are given for information purposes only without any responsibility for their use. It is expressly understood and agreed that the buyer's sole and exclusive remedy shall be the replacement of defective products, and under no circumstance, shall Specialized Construction Products Ltd be liable for incidental or consequential damages. Specialized Construction Products Ltd neither assumes, nor authorizes, any others to assume for it any liability with respect to furnishing of the product. Handling and use of the products are beyond the control of Specialized Construction Products Ltd; therefore, no warranty is made, expressed or implied, as to the results or on site quality that can be obtained from the use of the product.

The long-term durability of the Caviteclad system is dependent upon the correct preparation and application of all of its components in strict accordance with all the relevant written instructions and detail sheets. On-site application is beyond the control of Specialized Construction Products Ltd and it cannot guarantee workmanship or the correct preparation and application of its products or systems. The Certified Caviteclad contractor shall take the overall responsibility for; on-site supervision, staff training, installation, and quality control.

System guarantee period – 15 years from date of practical completion

Workmanship guarantee period – 5 years from date of practical completion.

■ Technical Assistance

Technical assistance and information is available by calling Specialized Construction Products Ltd at (09) 4144499 or FAX (09) 4144489 or by e-mail at specialized@xtra.co.nz.

Specialized Construction Products Ltd 16a Poland Road Glenfield Auckland NZ **tel** 09 414 4499 **fax** 09 414 4489